



Optical Fiber Diameter Analyser (OFDA100) Micron Test Report

Janette Archambault
411 Chemin De Brill, RR32 Bolton-Quest
QC J0E 2T0, CA

Date: 16-May-22
Shear ID:
Test No: 606110

Animal and Sample Description


Animal Name: Ariya Everlasting's Cybele
Registry #: 36185504
Breed: Huacaya
Sex: Female
Colour: 204 - Medium Fawn

Date of Birth (Age): 29-May-21
Sample Location: GRID
Sample Date: 15-Apr-22
Previous Shear Date:
Total Fleece Wt (lbs):

Laboratory Data

Mean Fiber Diameter: 16.4 microns
Standard Deviation: 3.7 microns
Coefficient of Variation: 22.7 %
Spin Fineness: 16.2 microns
Fibers Greater Than 30 microns: 0.4 %
Comfort Factor: 99.6 %

Mean Staple Length: 123 mm
Length Standard Deviation: 4.2 mm
Length Coefficient of Variation: 3.4 %
Mean Curvature: 54.4 deg/mm
SD Curvature: 24.4 deg/mm

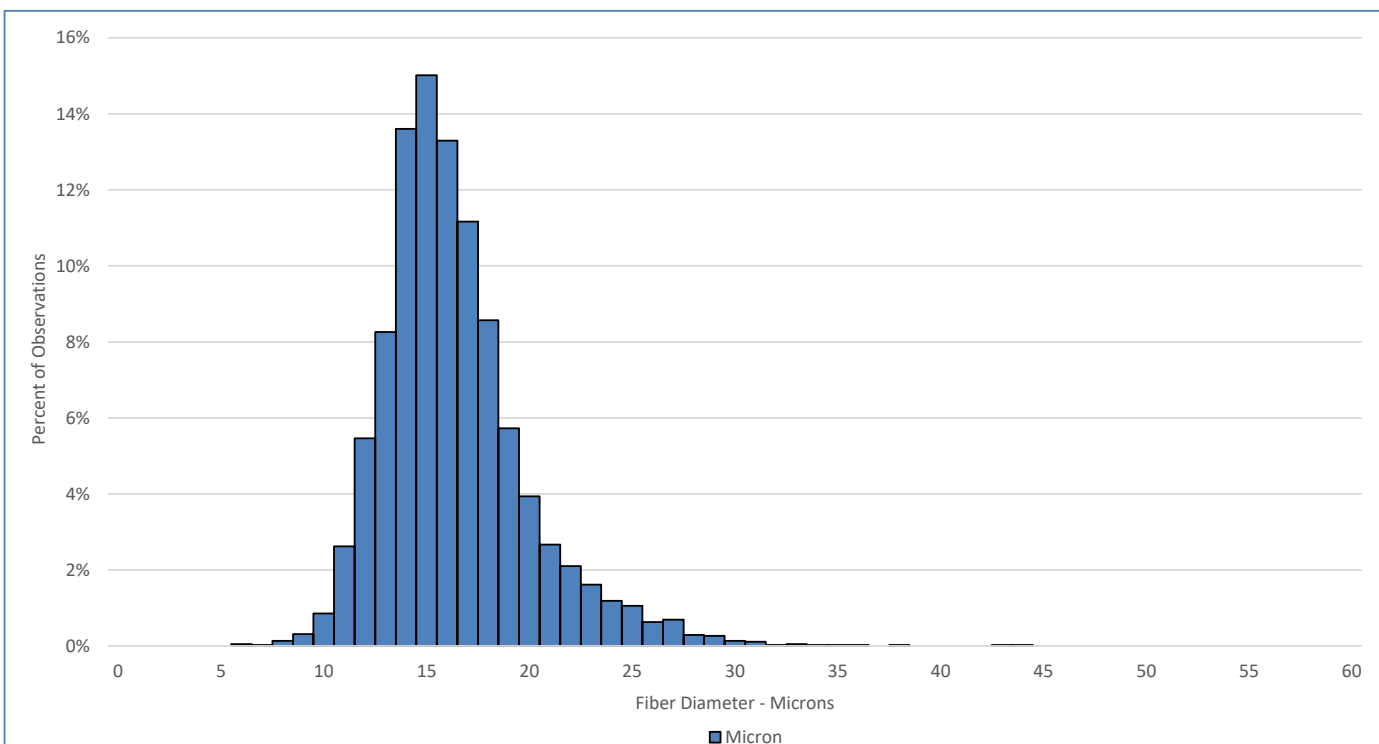

Test Performed According to Method AS/NZS 4492.5:2000

Jeremy Wear
Business Manager

Ioasa Kosena
Authorised Signatory

[SGS General Terms and Conditions](#)

The validity of this document may be confirmed by contacting the address shown below

SGS NZ LTD - 48 Kemp Street, Kilbirnie 6022, Wellington, New Zealand. Tel: 64-4-387 8565 Email: WoolOnline@sgs.com Web: www.wooltesting.sgs.com